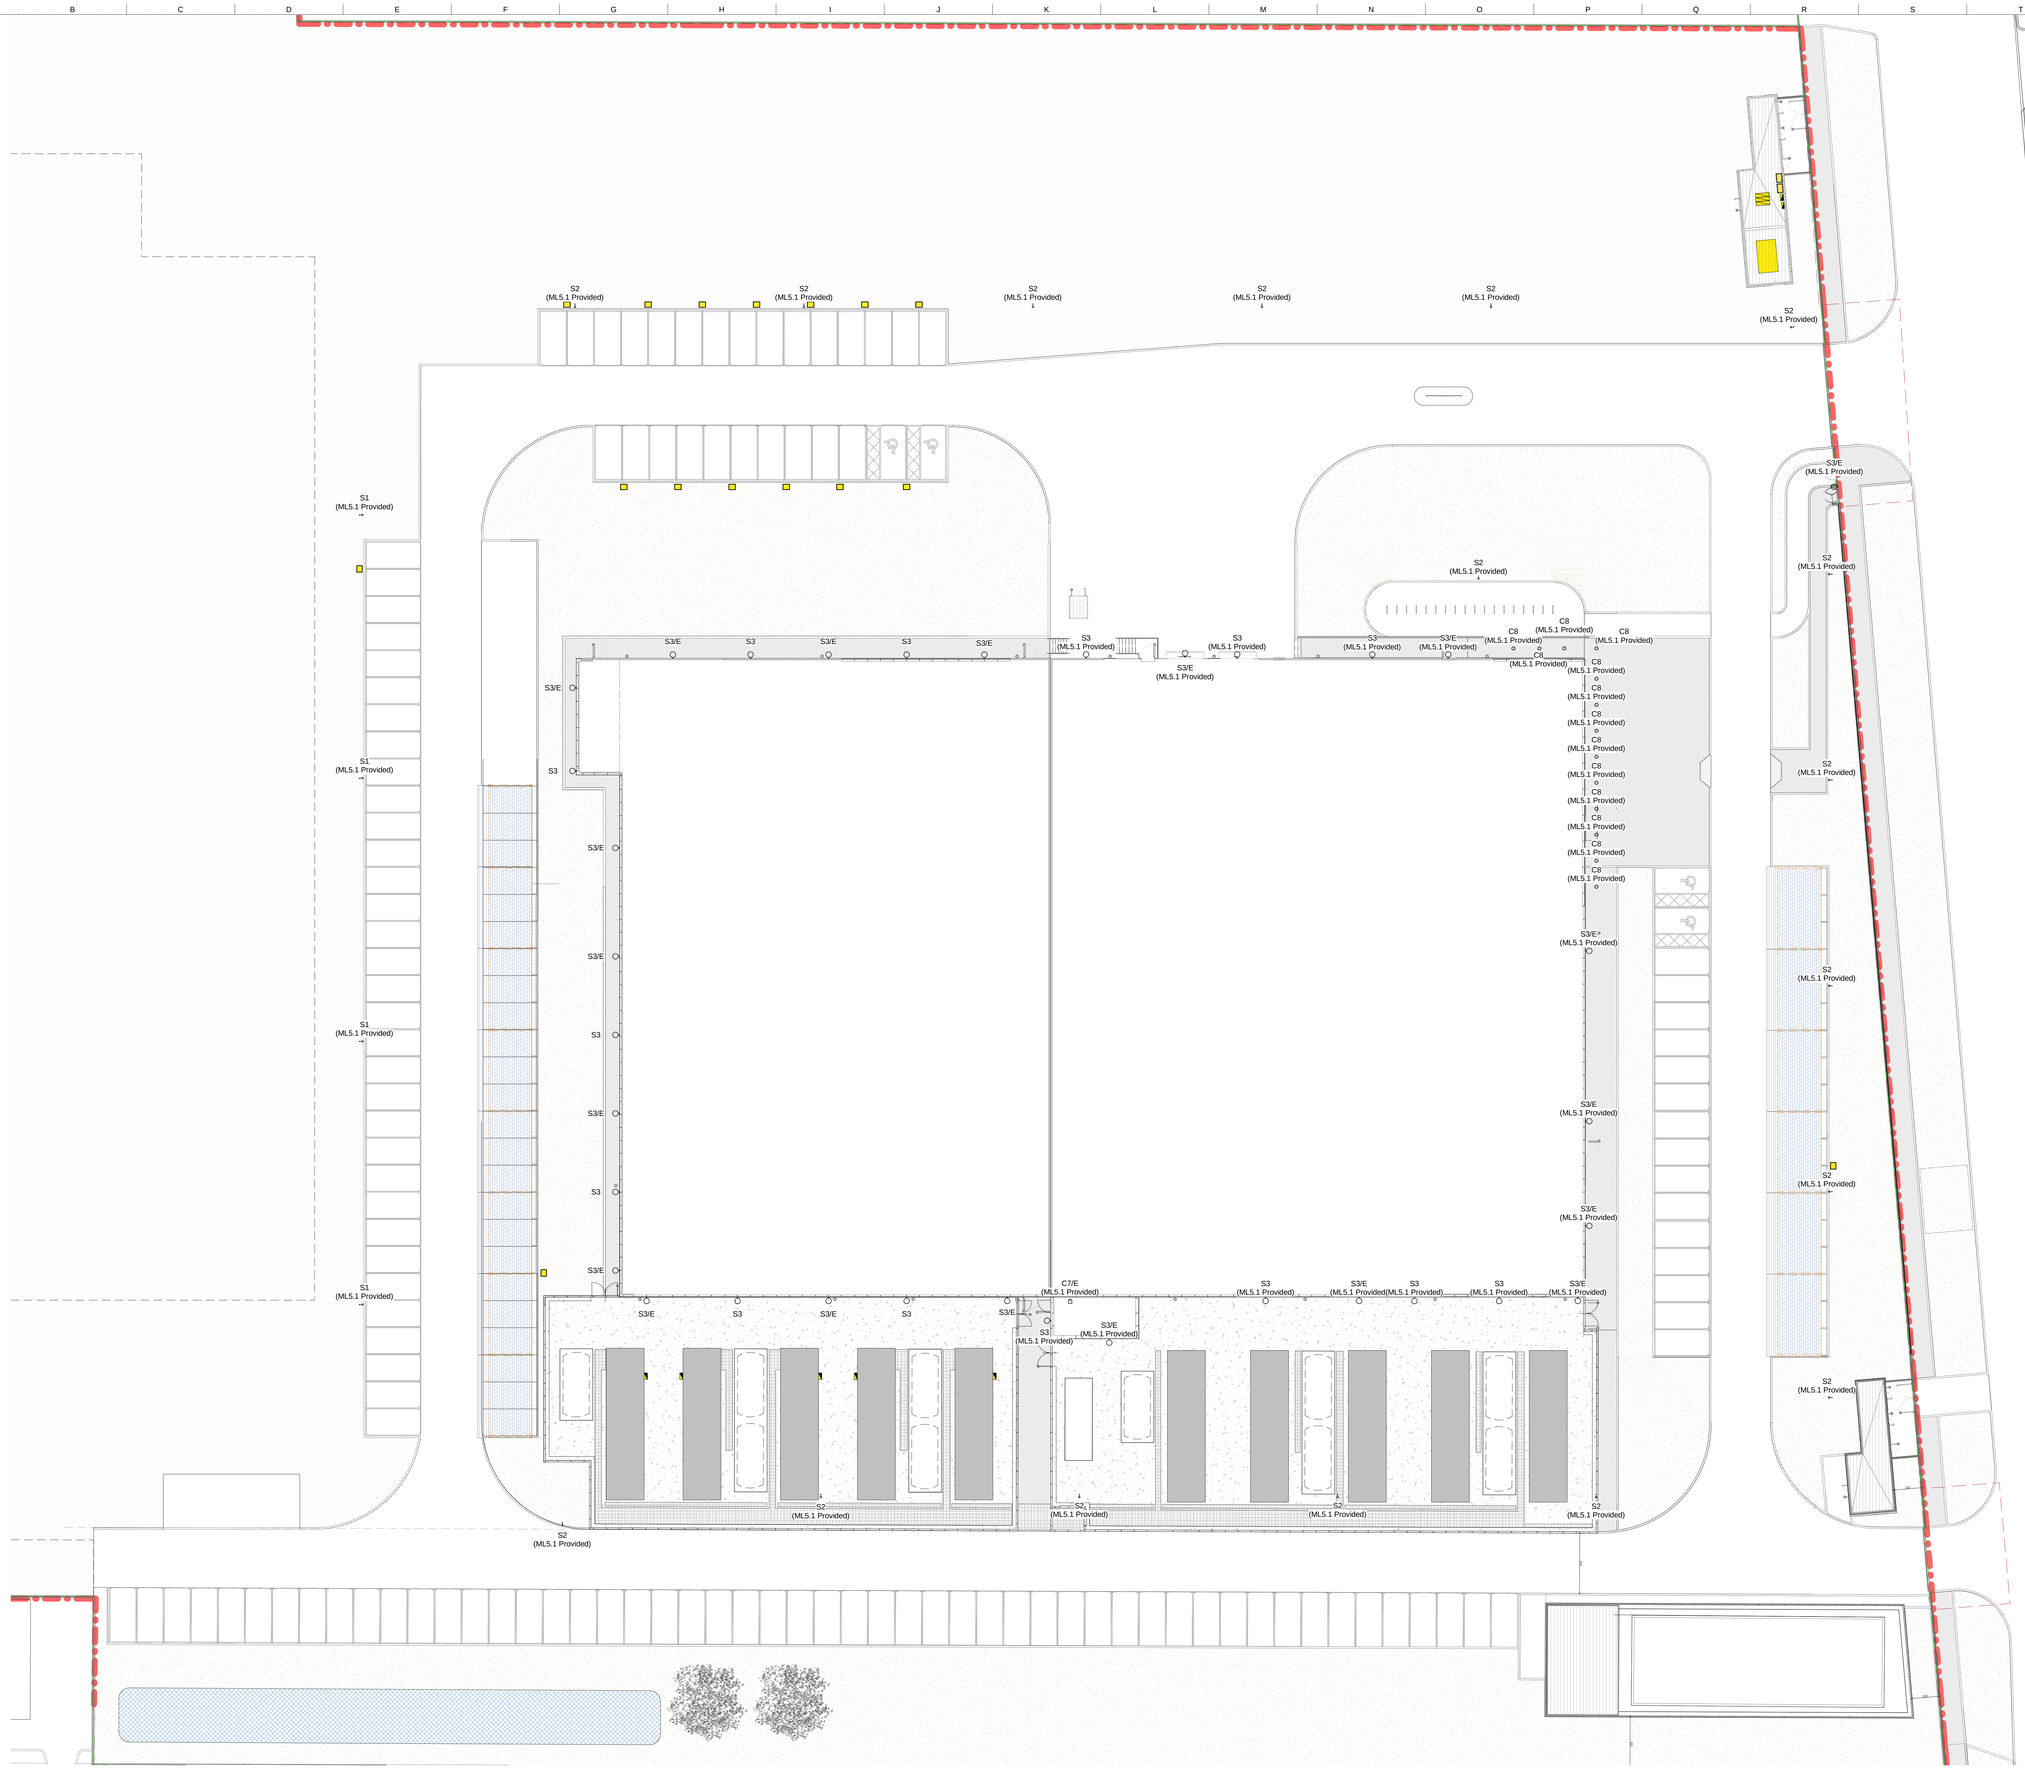

General Notes:

1. This drawing indicates RIBA Stage 3 design information for combined ML5.4, ML5.5, ML5.P1 & ML5.P2, defining the principles of the MEP services. The level of detail shown is in line with this stage of design development as defined by the BSRIA Design Framework B6 G2018. Due consideration shall be made when interpreting the design intent.
2. This drawing should be read in conjunction with the reference design documentation, work package scope of works, Equinix Global Design Standards and compliance checklist and all other supporting technical information forming part of the combined ML5 build. 2.
3. All dimensions in mm unless otherwise stated.
4. Do not scale from this drawing.
5. All plant and equipment is to be installed to manufacturer's recommendations, allowing full access for commissioning, maintenance and removal/ replacement.
6. All the MEP service system, their component and equipment are non-structural elements, the Italian Structural and Seismic Standard must to be applied (paragraph 7.3.6.2-7.3.6.3 of NTC 2018 - Technical Standards for intergrated constructions - DM 17/1/18 circular 21/1/19 No. 7).
7. The works shall be split in phases as indicated on architectural drawing ML052-ARP-00-ZZ-DR-A-PLAN-1005 and according to phase's demarcation lines. Contractor shall provide all the temporary works and provisions to allow full functionality of the building in each phase and to allow the completion of the future fit-out works.
8. Building 2 is the extension of the building 1 and all the electrical systems should be the same in case of extension (Eg. EVAC, fire detection, etc.). GC shall refer to ML5.1 RIBA4 + RIBAS construction drawings. Material samples are required for approval in case any element provided for Building 2 may be different from what installed in ML5 Building 1.
9. All interfaces between the two buildings are to be carefully designed by GC to guarantee the functionality and interface with the electrical system of Building 1. GC to guarantee long durability and robustness of all interface details.

Lighting Symbols:

S1	Pole mounted narrow beam LED external luminare c/w 6m pole and foundation cage
S2	Pole mounted wide beam LED external luminare c/w 6m pole and foundation cage
S3	Urban external LED luminaires. Wall and pole mounted.
S3/E	Urban external LED luminaires. Wall and pole mounted. C/w 3hr emergency battery backup

Lighting Lux Levels (Avg)

Roads: 5lx with 0.4 uniformity

Bounday Lines: Less than 0.5lx

Bicycle Racks: 5lx and 0.25 uniformity

Car Park: 10lx and 0.25 uniformity

Walkways: 5lx and 0.25 uniformity

Pedestrian Entrance: 5lx and 0.25 uniformity

Bicycle Entrance: 10lx and 0.25 uniformity

Loading Bay: 20lx and 0.25 uniformity

Building Entrances: 20lx and 0.5 uniformity

NOTE:
For all external electrical supplies to be coordinated with civil package.

Rev	Date	By	Chkd	Appd
P02	17/04/2020	PT	NC	NC
S3 - For Formal Review				

ARUP

Corso Italia 1
20122 Milan
Tel +39 02 8597 9301
www.arup.com

Client
Equinix

EQUINIX

Project Title
ML5 - Building 2

Drawing Title
Electrical Services
Lighting Layout
External

Scale at A0: As indicated

Role: Electrical Services

Suitability: S3 - For Formal Review

Arup Job No: **272509-00**

Rev: **P02**

Name: **ML052-ARP-00-0G-DR-E-LITE-1060**

A0 — Do not scale

© Arup